



DATE	REVISION

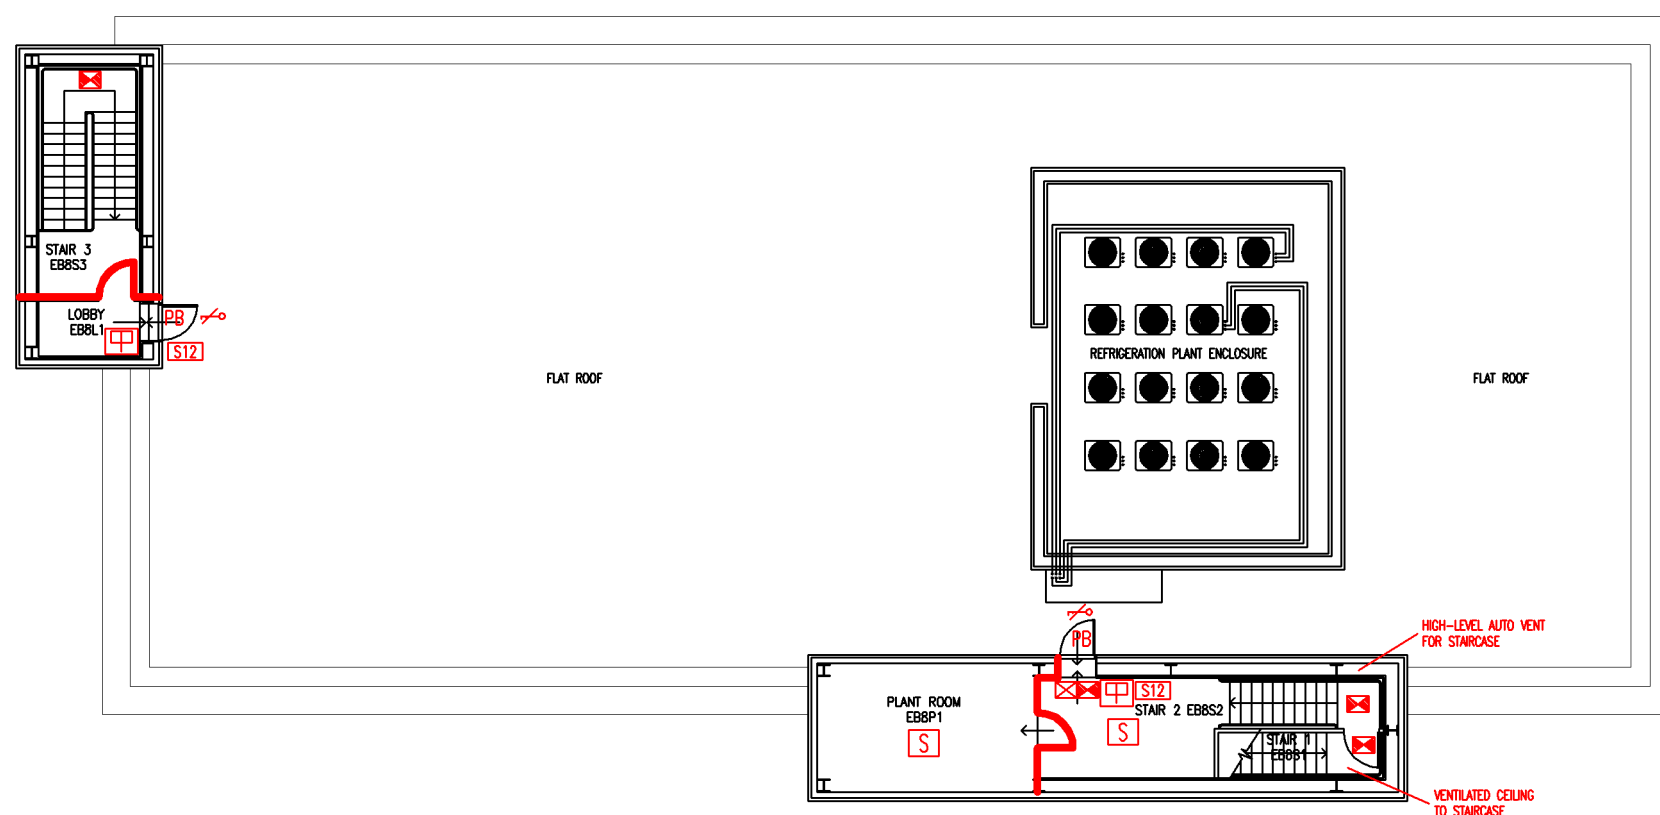

- Existing 30-minute fire resisting construction
- PB Existing call point – manual
- S Existing smoke detector
- EXIT Existing exit sign – internally illuminated
- E Existing emergency lighting luminaire – self contained
- PB Existing pushbar door ironmongery
- / Door fitted with lock which is immediately openable from side indicated, without the use of a key or draw/barrel bolt
- S12 Existing fire action sign – general

EIGHTH FLOOR  
(ROOF). FIRE  
EQUIPMENT PLAN

EXECUTIVE BUSINESS  
CENTRE

EB/FP/9

SCALE 1:200 at A3  
NOVEMBER 2009

