


DATE	REVISION
A 20.12.06	PLAN UPDATED FOLLOWING INSTALLATION OF DDA LIFTS
B 4.9.07	SERVIFY AREA ADDED IN PG60 NEW EXTERNAL DOORS ADDED IN SPORTS HALL DOOR POSITION OF PG42 AMENDED DEMT WALL REMOVED FROM PG63
C 6.10.08	PLAN UPDATED FOLLOWING REFURB TO ATRIUM
D 2.2.11	PLAN UPDATED FOLLOWING FSD SURVEY
E 16.9.11	PS51 COMBINED WITH PS52 & PS53 TO FORM LARGER FITNESS SUITE PLAN UPDATED FOLLOWING WORKS TO FORM SANTANDER BANK
F 31.8.12	PLAN UPDATED FOLLOWING REFURBISHMENT TO SPORTS HALL & SPORTS RECEPTION AREA
G 30.11.12	UPDATE FOLLOWING CONSTRUCTION OF BIOMASS BOILER
H 8.3.13	PLAN UPDATED FOLLOWING WORKS TO PG63 FOR HSC
J 10.4.13	MAXIMUM OCCUPANCY OF PG60 ADDED AS FSD COMMENTS
K 21.8.13	PLAN UPDATED FOLLOWING WORKS TO PG48 & PG48a SUB-STATION ADDED
L 30.9.14	MAXIMUM OCCUPANCY OF ATRIUM ADDED AS FSD COMMENTS
M 20.1.15	"CLEAR AREA" OUTLINE ADDED TO ATRIUM
L 10.9.15	STUDENT CENTRE OUTLINE, SHARED DOORS & WINDOWS & SPORTS RECEPTION LINK ADDED
M 17.1.16	UPDATE FOLLOWING REFURBISHMENTS TO PG47-48a & PG60-PG61a & PG63-63a
N 3.10.18	PS59a CHANGED TO "VACANT" FOLLOWING REMOVAL OF ATM
P 30.7.20	DOOR BETWEEN PG60 & PG61 REMOVED
Q 12.2.21	PG40 AREA UPDATED FOLLOWING SANTANDER EXIT & "SS" MOVE FROM MELBURY HOUSE

Student Centre

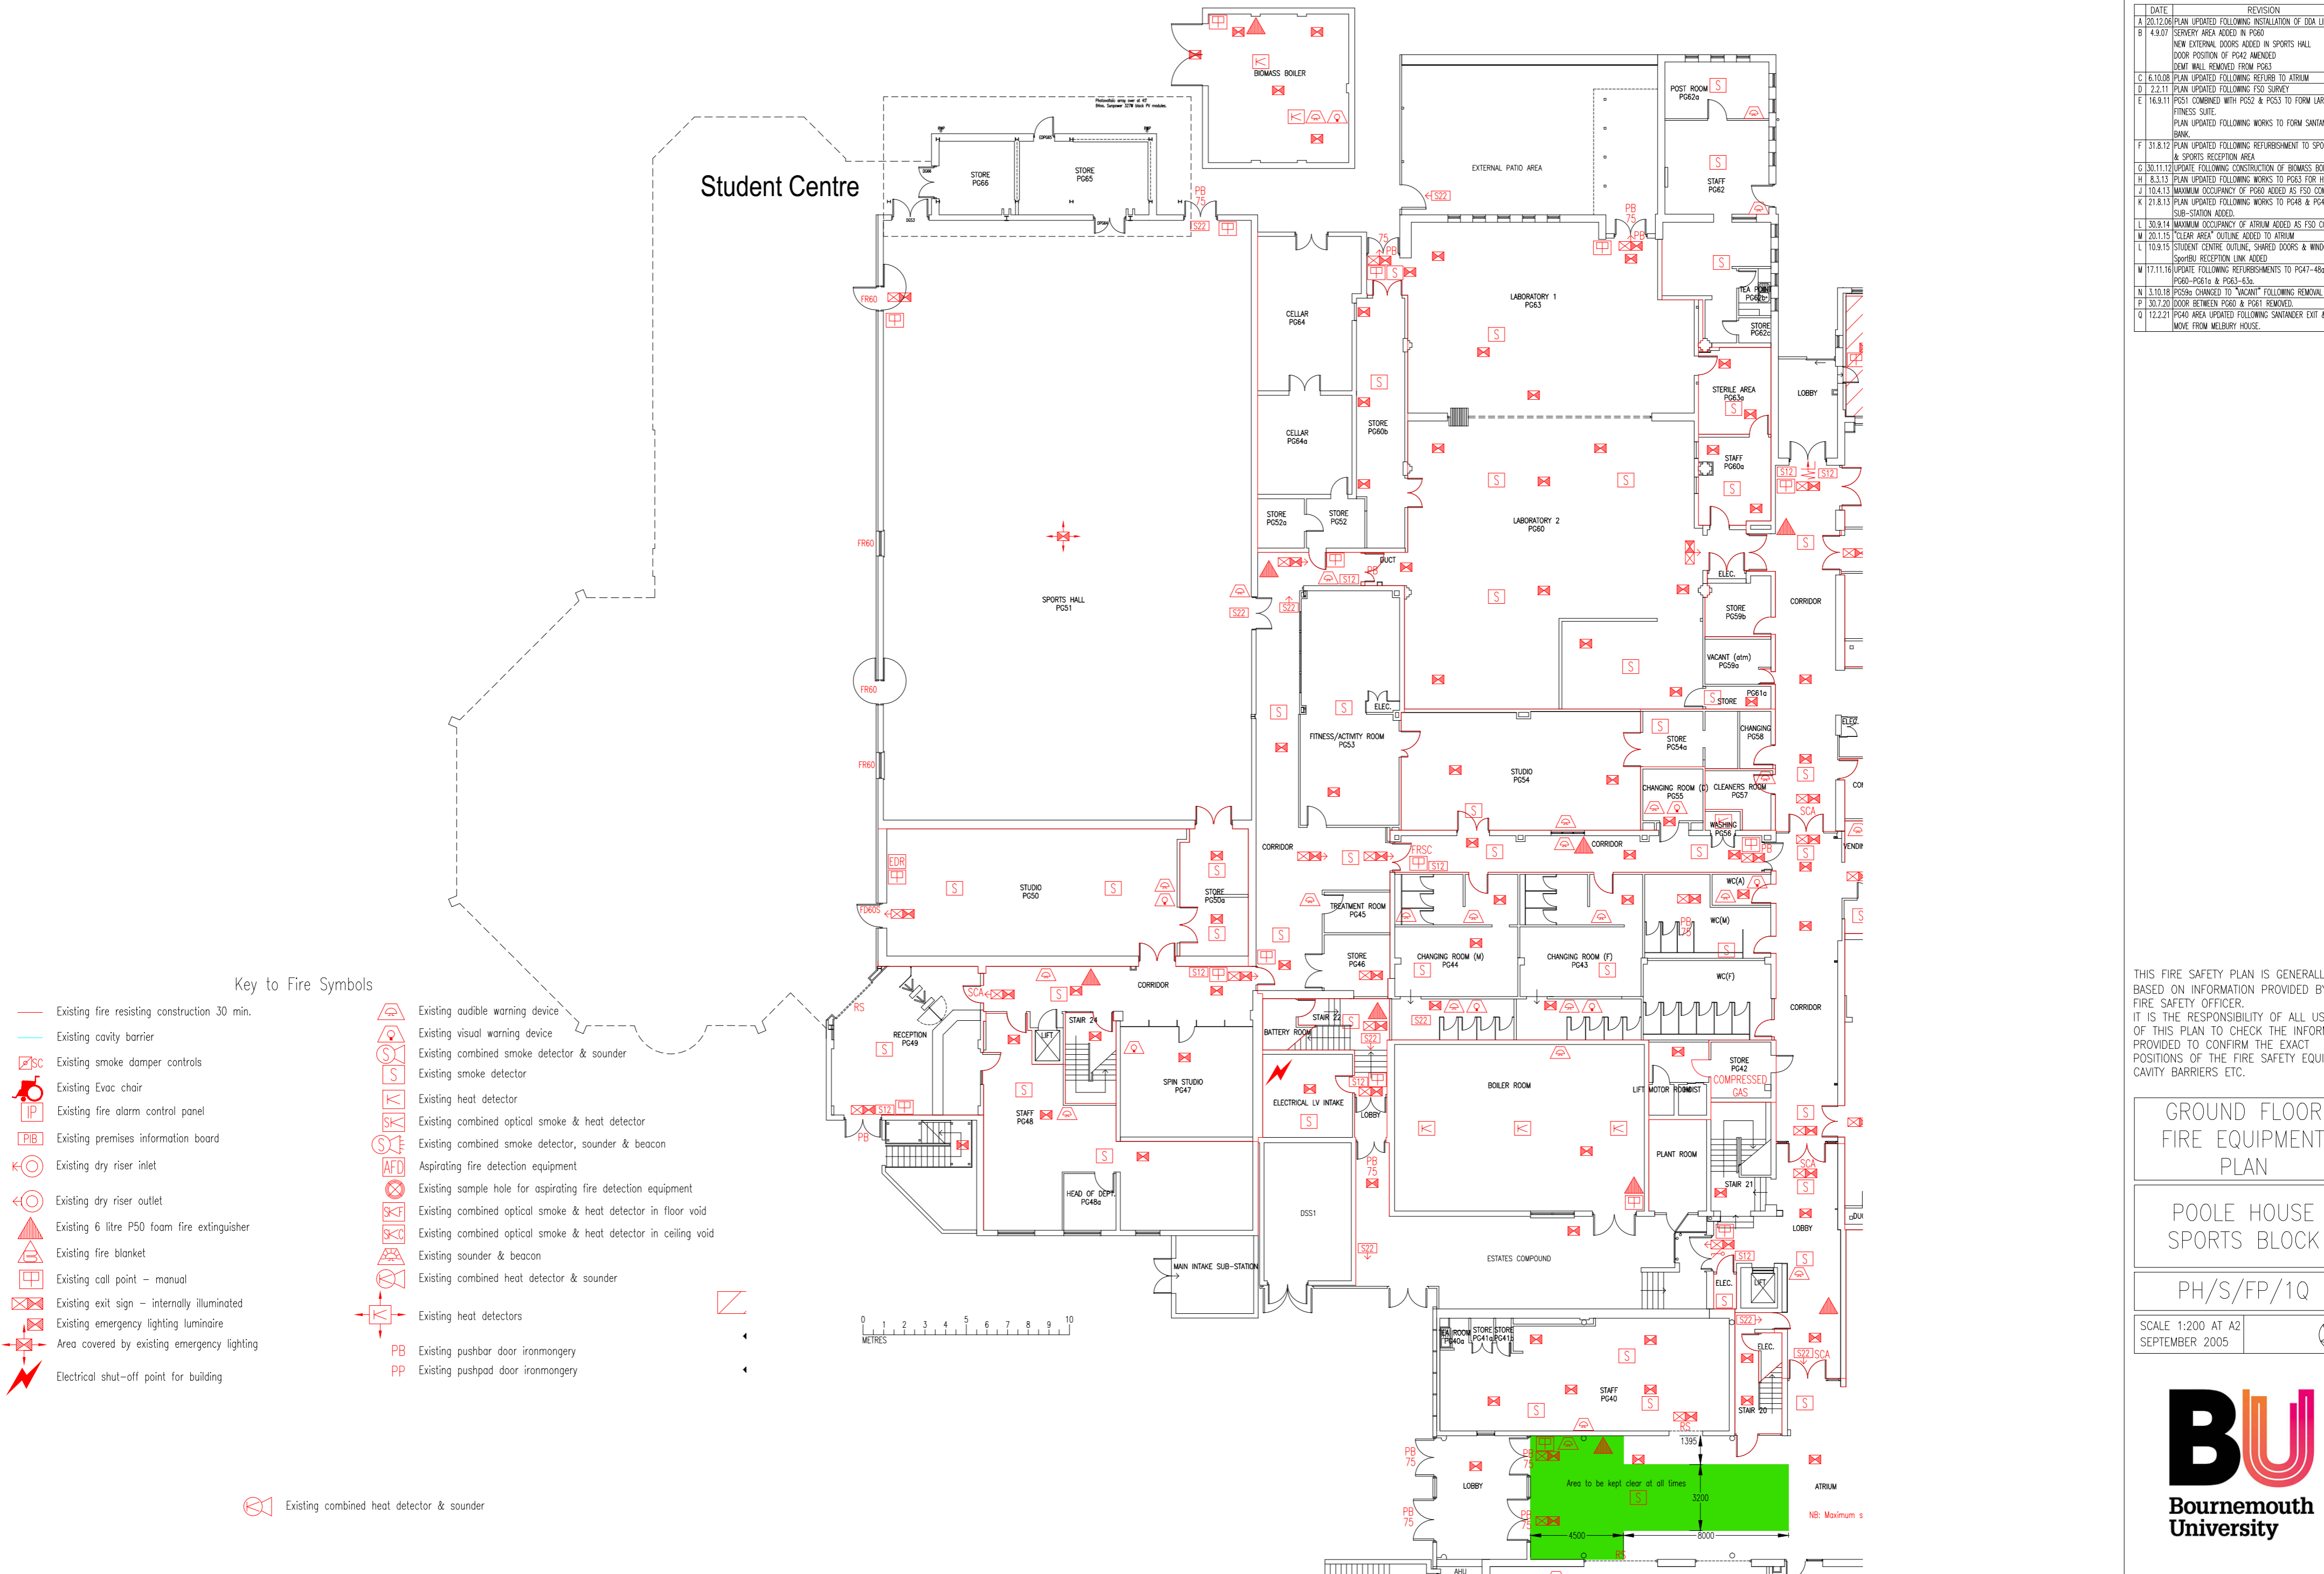

Key to Fire Symbols

- Existing fire resisting construction 30 min.
- Existing cavity barrier
- Existing smoke damper controls
- Existing Evac chair
- Existing fire alarm control panel
- Existing premises information board
- Existing dry riser inlet
- Existing dry riser outlet
- Existing 6 litre P50 foam fire extinguisher
- Existing fire blanket
- Existing call point - manual
- Existing exit sign - internally illuminated
- Existing emergency lighting luminaire
- Area covered by existing emergency lighting
- Electrical shut-off point for building
- Existing audible warning device
- Existing visual warning device
- Existing combined smoke detector & sounder
- Existing smoke detector
- Existing heat detector
- Existing combined optical smoke & heat detector
- Existing combined smoke detector, sounder & beacon
- Aspirating fire detection equipment
- Existing sample hole for aspirating fire detection equipment
- Existing combined optical smoke & heat detector in floor void
- Existing combined optical smoke & heat detector in ceiling void
- Existing sounder & beacon
- Existing combined heat detector & sounder
- Existing heat detectors
- Existing pushbar door ironmongery
- Existing pushpad door ironmongery
- Existing combined heat detector & sounder

THIS FIRE SAFETY PLAN IS GENERALLY BASED ON INFORMATION PROVIDED BY BU'S FIRE SAFETY OFFICER. IT IS THE RESPONSIBILITY OF ALL USERS OF THIS PLAN TO CHECK THE INFORMATION PROVIDED TO CONFIRM THE EXACT POSITIONS OF THE FIRE SAFETY EQUIPMENT, CAVITY BARRIERS ETC.

GROUND FLOOR FIRE EQUIPMENT PLAN

POOLE HOUSE SPORTS BLOCK

PH/S/FP/1Q

SCALE 1:200 AT A2
SEPTEMBER 2005

