


DATE	REVISION
A 12.10.12	REFUGE ADDED

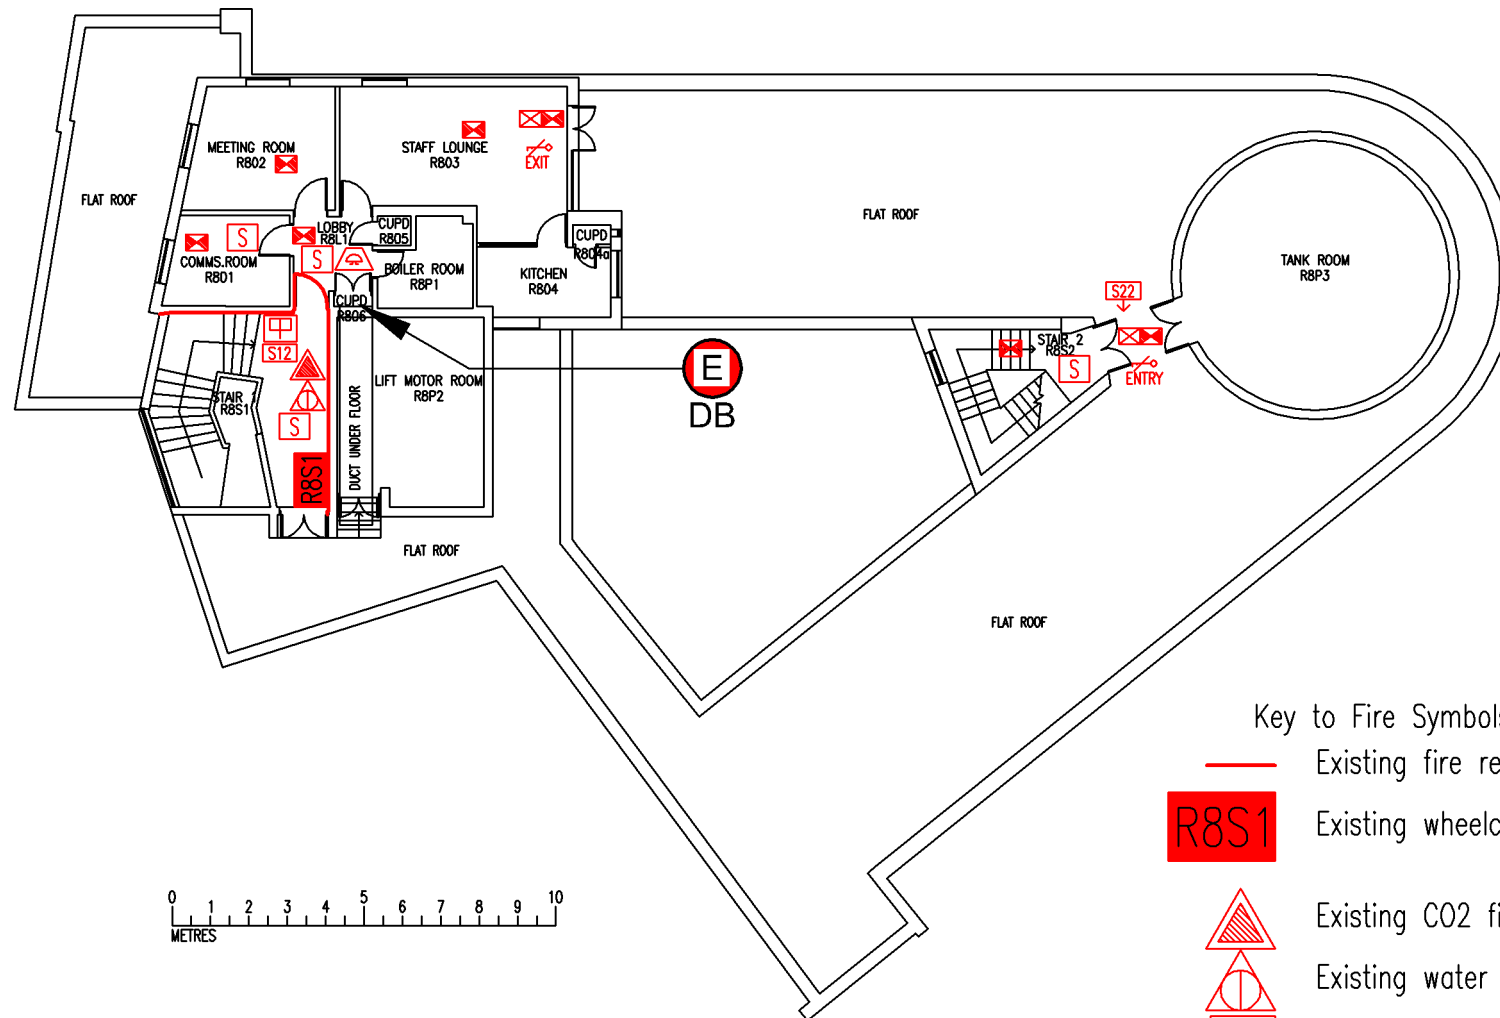

Key to Fire Symbols (as existing 12/10/12)

- Existing fire resisting construction 30 min.
- Existing wheelchair refuge zone
- Existing CO2 fire extinguisher
- Existing water fire extinguisher
- Existing call point – manual
- Existing audible warning device – bell
- Existing smoke detector
- Existing exit sign – internally illuminated
- Existing emergency lighting luminaire – self contained
- Existing fire action sign – general
- Existing fire exit sign
- Denotes directional arrow on existing fire exit sign
- Door fitted with lock which is immediately openable from side indicated, without the use of a key or draw/barrel bolt

Key to Existing Services Symbols :

- Electric distribution board
- DB

EIGHTH FLOOR  
FIRE EQUIPMENT  
PLAN

ROYAL LONDON  
HOUSE

RLH/FP/8A

SCALE 1:200 at A3  
MAY 2010

