





























Key to Fire Symbols

-  Existing wheelchair refuge zone & intercom
-  Existing Evac chair
-  Existing fire resisting construction 30 min.
-  Existing fire alarm control panel
-  Premises information board
-  Existing roller shutter
-  Existing 6 litre P50 foam fire extinguisher
-  Existing call point – manual
-  Directional arrow
-  Existing exit sign – internally illuminated
-  Existing emergency lighting luminaire
-  Existing audible warning device
-  Existing smoke detector
-  Existing combined smoke detector, sounder & beacon
-  Existing heat detector
-  Existing pushbar door ironmongery
-  Existing self closing device fitted to door
-  Existing self closing automatic release
-  Existing vision panel
-  Roller shutter
-  Existing fire action sign – general
-  Existing fire exit sign
-  Denotes directional arrow on existing fire exit sign
-  Electro mechanical lock
-  Area covered by existing emergency lighting
-  Area covered by existing smoke detection
-  Electrical shut-off point for building

| DATE | REVISION |
|------------|--|
| A 17.10.05 | DLG19 & DLG22 BOTH CONVERTED INTO TWO ROOMS |
| B 24.8.06 | PLAN UPDATED FOLLOWING FORMATION OF DLG13a |
| C 3.1.07 | PLAN UPDATED FOLLOWING FORMATION OF LEARN HIGHER FACILITY |
| D 29.3.10 | PLAN UPDATED FOLLOWING FSO'S SURVEY |
| E 5.10.10 | ALTERATIONS TO DLG03 AREA FOR SAS FOLLOWING ITS MOVE |
| F 13.9.11 | ALTERATIONS TO THE EDGE (DLG08) FOR SAS. |
| G 23.8.12 | PLAN UPDATED FOLLOWING FSO'S SURVEY |
| H 15.2.13 | SERVICES CUPD DLG22 CHANGED TO IT STORE DLG40 FOLLOWING IT ANNUAL SURVEY RETURN. |
| J 12.3.13 | WHOLE OF SIR MICHAEL COBHAM LIBRARY INCORPORATED ON ONE FLOOR PLAN, DRAWING TITLE UPDATED TO SUIT. |
| K 19.8.13 | UPDATE FOLLOWING INSTALLATION OF STORAGE SYSTEM, ROLLER SHUTTER & SECURITY GATES IN DLG25 |
| L 8.1.14 | DLG22 & DLG22a UPDATED TO 'STAFF' |
| M 14.10.14 | DLG14 UPDATED FROM 'CLEANERS STORE' TO 'STORE' |
| N 28.10.14 | ONE SET OF EXTINGUISHERS REMOVED FROM OUTSIDE DLG02 FOLLOWING FSO SURVEY |
| P 19.12.14 | DLG22/22a COMBINED TO FORM TRAINING ROOM FOR SSS. |
| Q 23.9.16 | EXTINGUISHER POSITIONS & TYPES UPDATED |
| R 12.10.16 | FIRE ALARM PANEL ADDED |
| S 23.5.17 | ELECTRICAL SHUT-OFF POINT ADDED |
| T 9.8.17 | UPDATE FOLLOWING REFURBISHMENT TO DLG17 AREA |
| U 17.9.18 | DLG08 RENAMED AS 'CAREERS CENTRE' |
| V 10.1.19 | UPDATE FOLLOWING CHANGES TO ENTRANCE LOBBY. |
| W 25.9.19 | DLG01 WINDOWS ADDED. |
| X 18.7.23 | UPDATE FOLLOWING WORKS TO FORM DC OFFICE IN DLG08. DLG14 RENUMBERED. |
| Y 13.10.23 | UPDATE FOLLOWING REFURBISHMENT WORKS TO FORM 'GROUP STUDY' ROOMS. |
| Z 9.1.24 | NEW LIFT & LOBBY ADDED. |

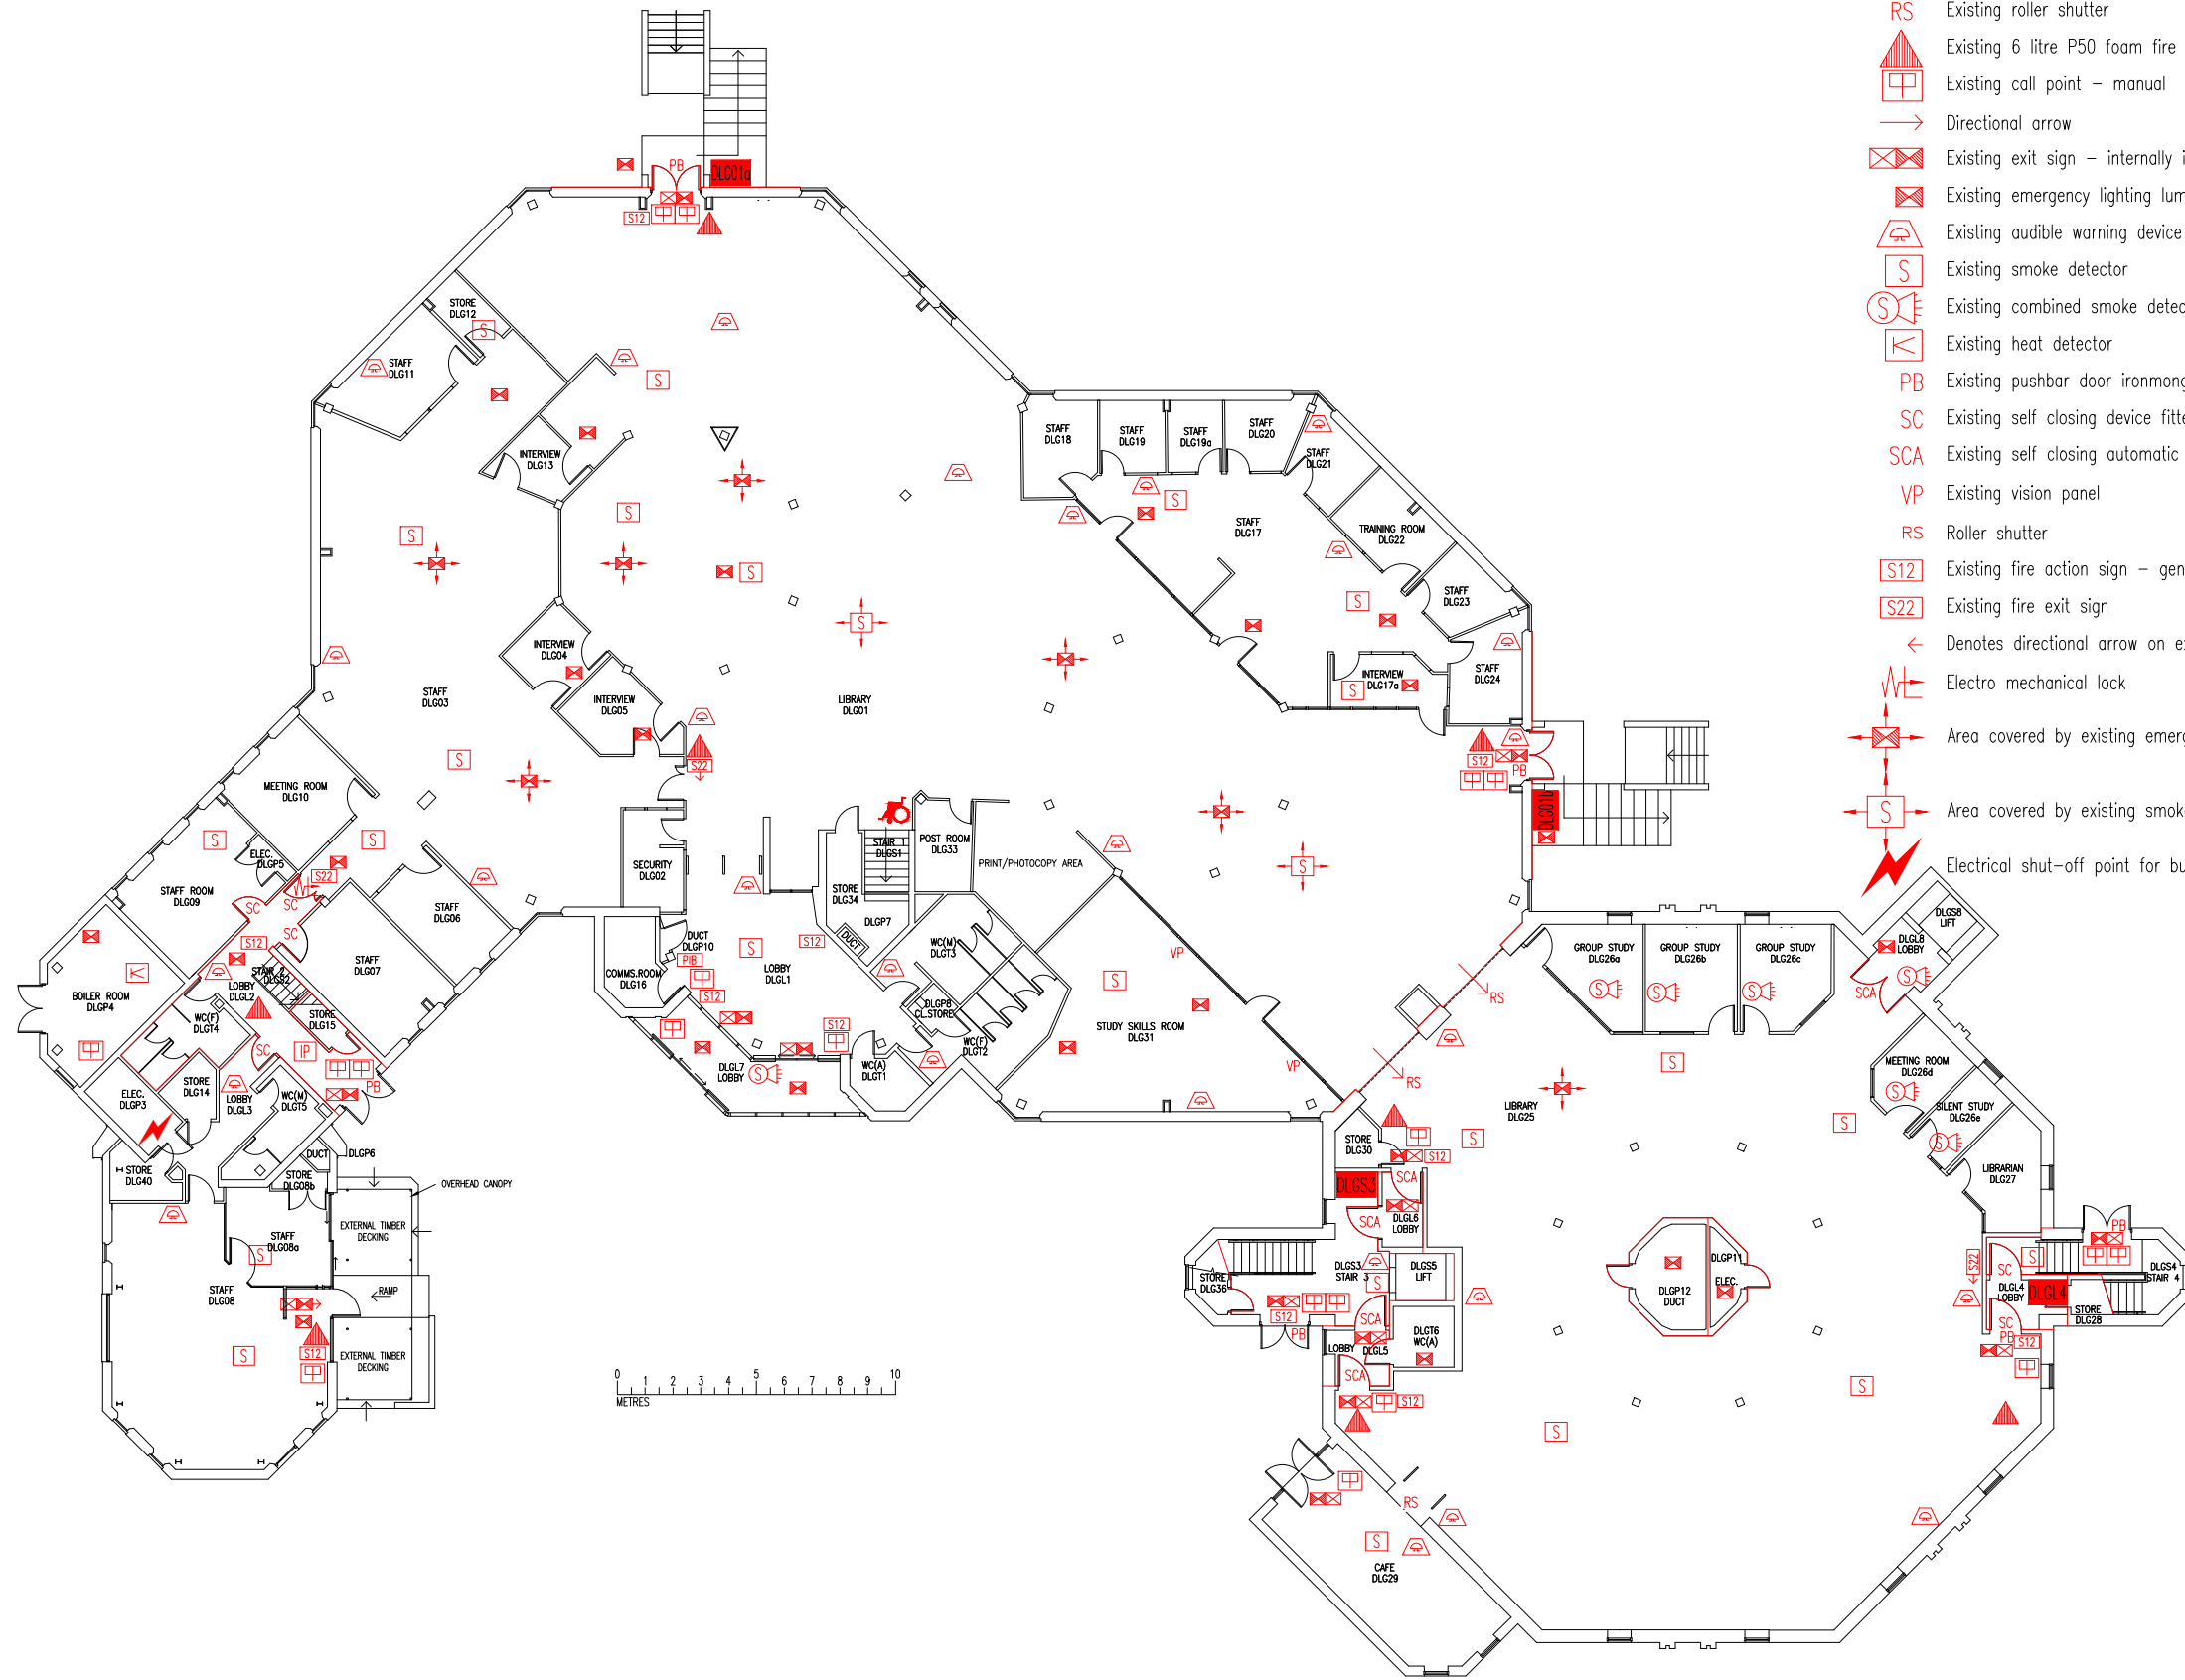

GROUND FLOOR
FIRE EQUIPMENT
PLAN

SIR MICHAEL
COBHAM
LIBRARY

DHL/FP/1Z

SCALE 1:250 at A3
FEBRUARY 2004

