










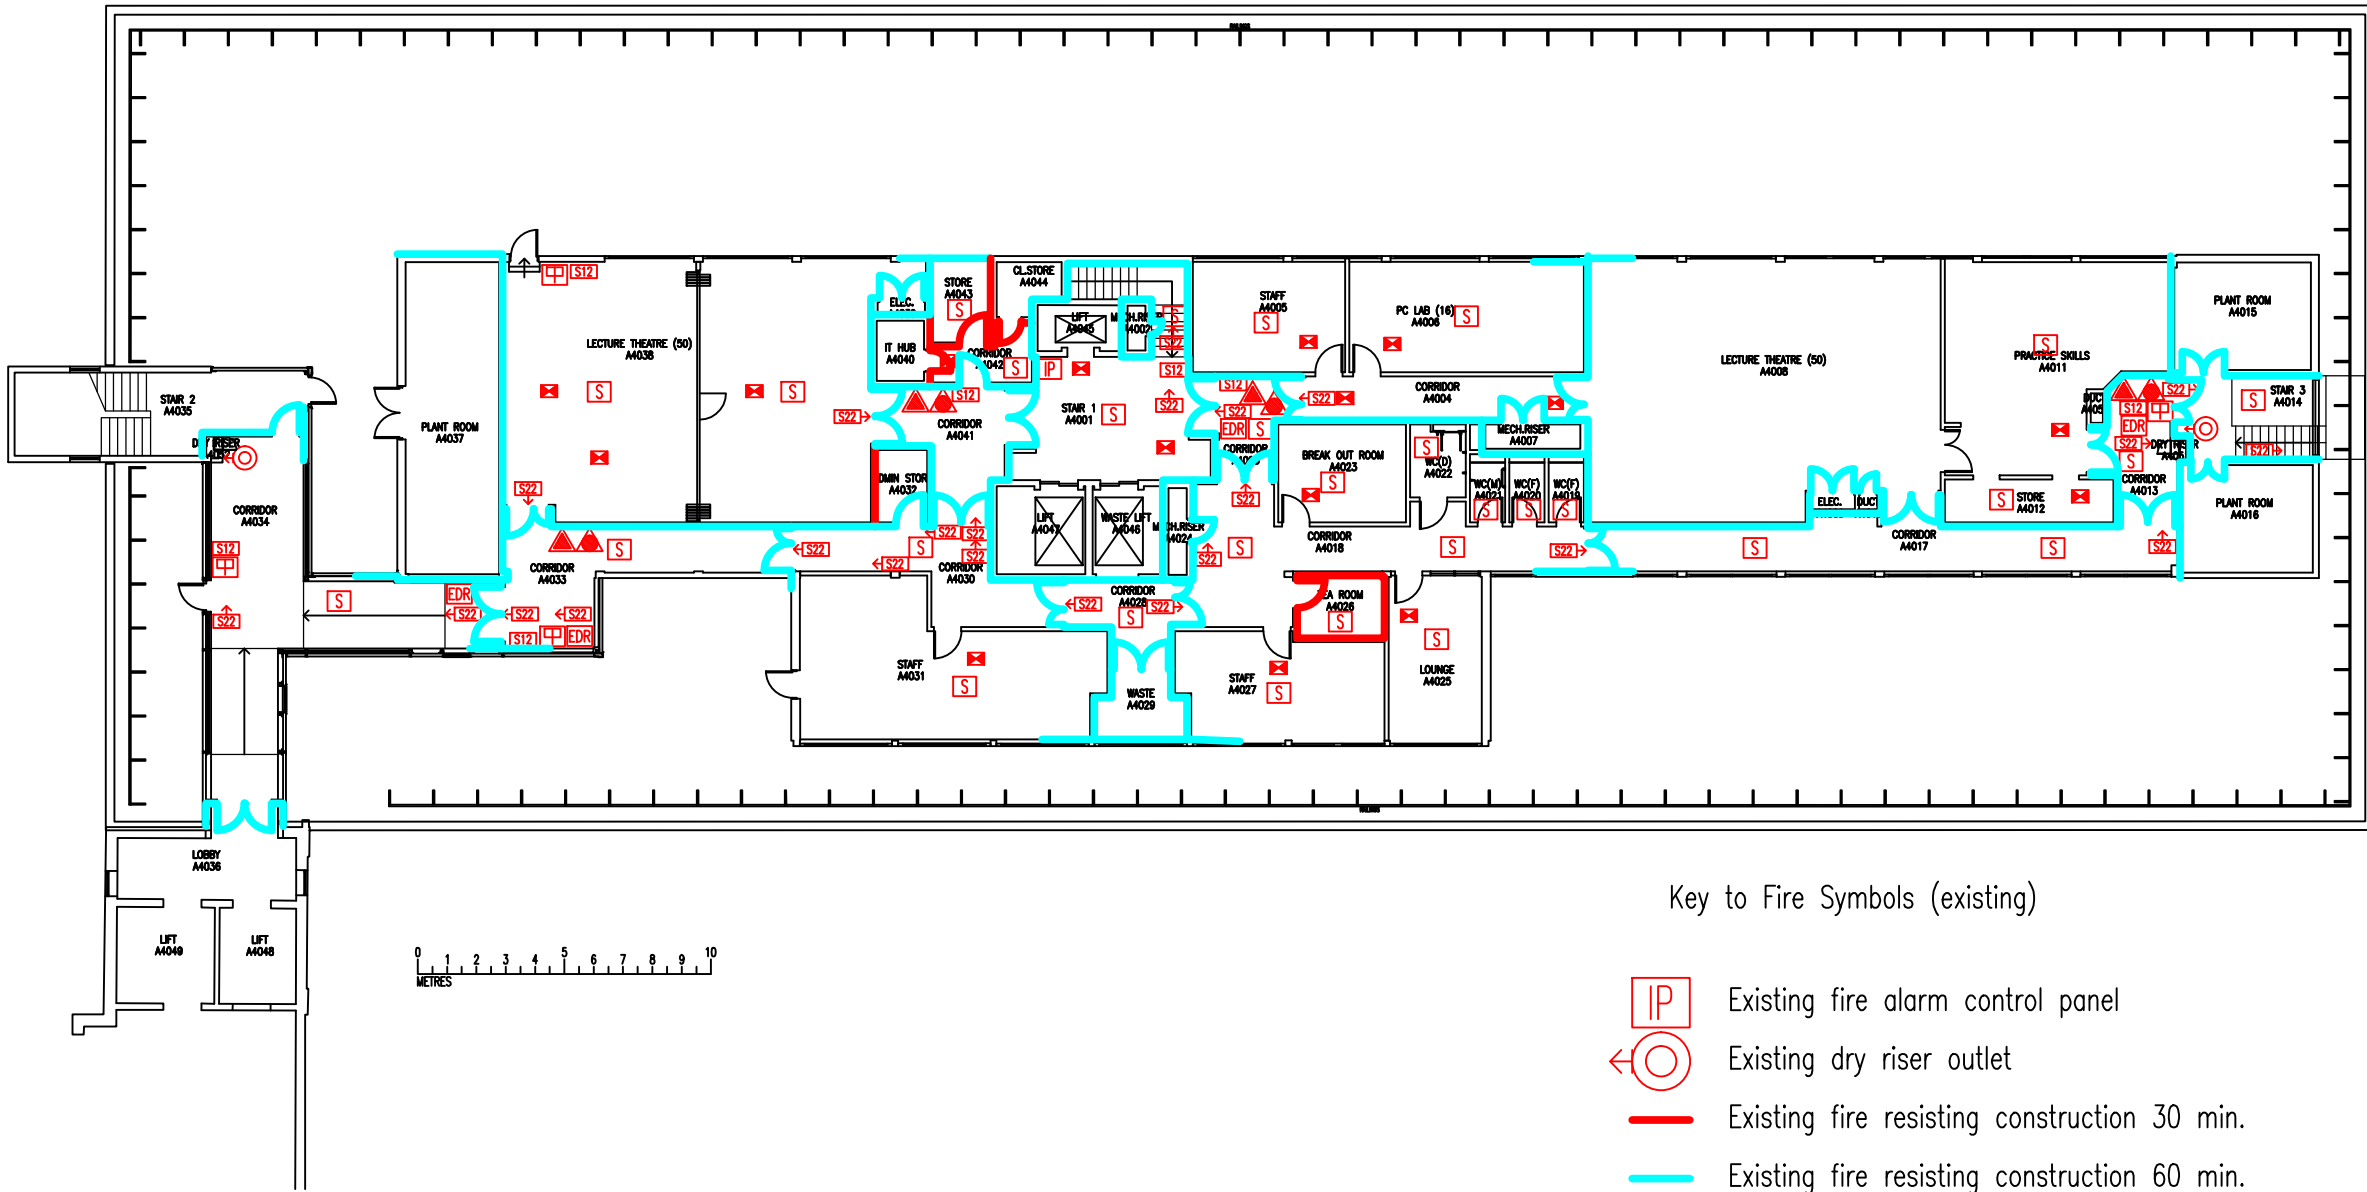




DATE	REVISION
A 29.5.12	FIRE WALLS & DOORS ADDED FOLLOWING CONFIRMATION OF POSITIONS BY STUDIO 4 ARCHITECTS
B 27.1.15	A4023 CHANGED TO 'STAFF'
C 11.1.16	A4005 CHANGED TO 'STAFF' & A4023 CHANGED TO 'BREAK OUT RM.'



Key to Fire Symbols (existing)

-  Existing fire alarm control panel
-  Existing dry riser outlet
-  Existing fire resisting construction 30 min.
-  Existing fire resisting construction 60 min.
-  Existing emergency door release call point – manual
-  Existing C02 fire extinguisher
-  Existing foam fire extinguisher
-  Existing call point – manual
-  Existing smoke detector
-  Existing emergency lighting luminaire – self contained
-  Existing fire action sign – general
-  Existing fire exit sign
-  Denotes directional arrow on existing fire exit sign

FOURTH FLOOR  
FIRE PLAN

ST. MARY'S HOSPITAL  
PORTSMOUTH

SM/FP/1C

SCALE 1:250 at A3  
17th APRIL 2012

