











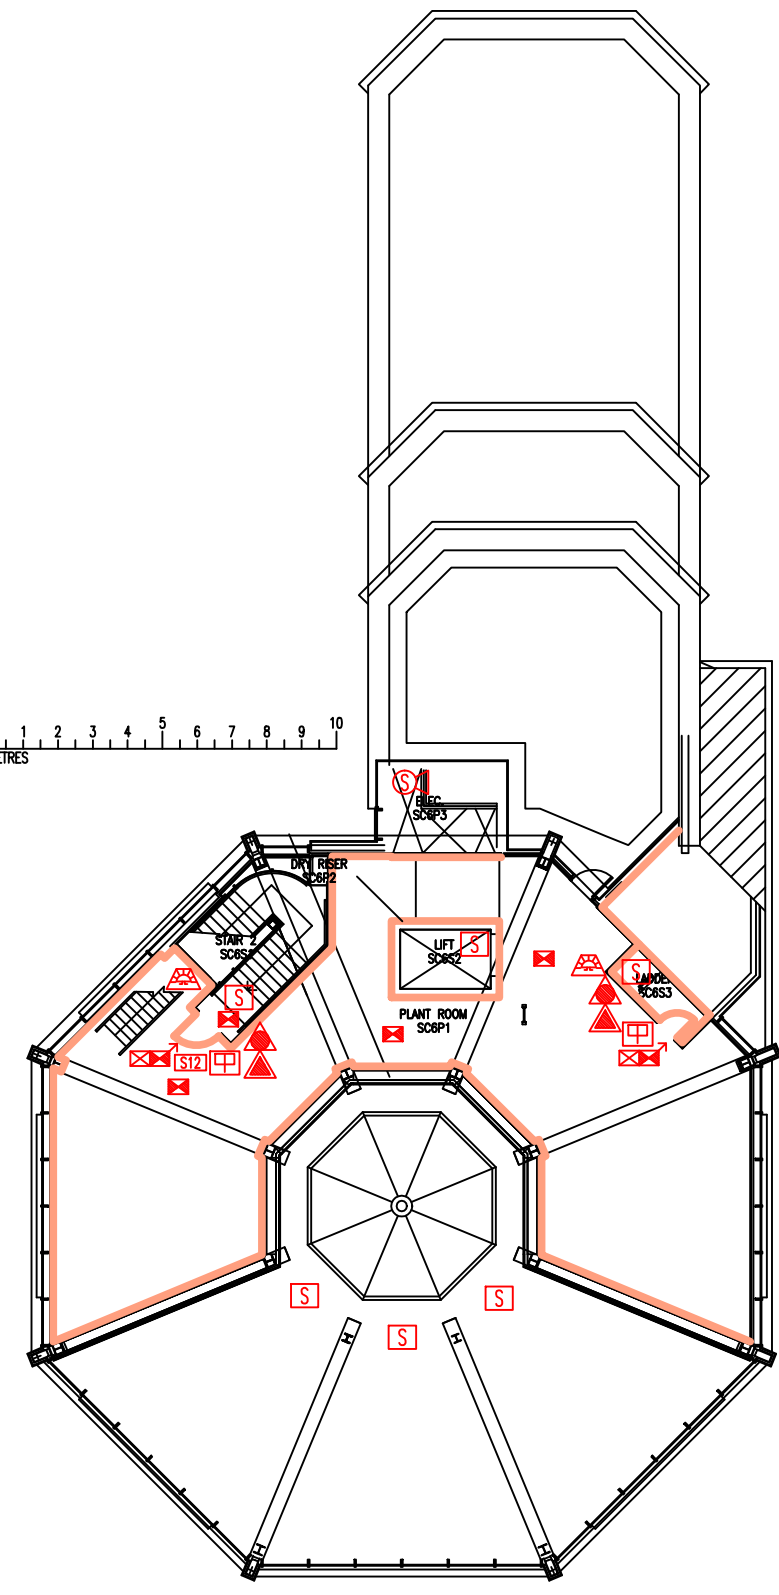



DATE	REVISION

-  Existing fire resisting construction minimum 30 minutes
-  Existing fire resisting construction minimum 60 minutes
-  Existing foam fire extinguisher
-  Existing CO2 fire extinguisher
-  Existing manual call point
-  Existing smoke detector
-  Existing smoke detector c/w sounder base
-  Existing sounder & beacon
-  Existing internally illuminated exit sign
-  Denotes directional arrow on existing fire exit sign
-  Existing emergency lighting luminaire
-  Existing fire action sign - general



SIXTH FLOOR FIRE PLAN	
STUDENT CENTRE	
SC/FP/7	
SCALE 1:200 at A3 MARCH 2015	