
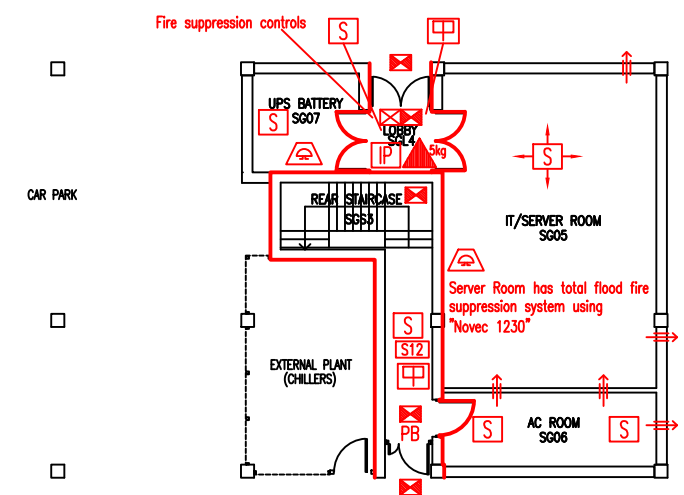
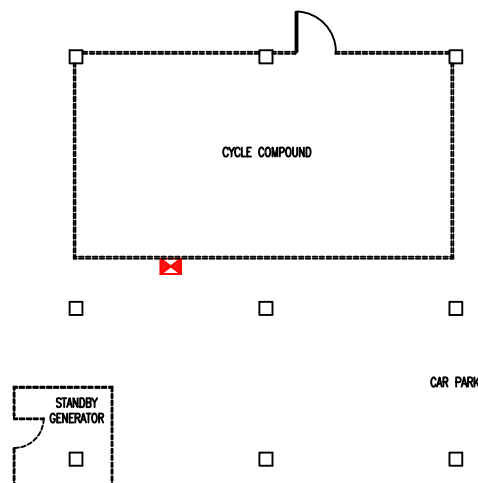


DATE	REVISION
A 26.9.06	ITS SERVER ROOM SUITE ADDED, S603 VACATED.
B SEPT.08	UPDATE FOLLOWING MAJOR REFURBISHMENT OF GF & RE-CLAD PROJECT
C 27.7.10	GENERAL UPDATE FOLLOWING FSO SURVEY
D 28.9.10	GENERAL UPDATE FOLLOWING FSO SURVEY
E 15.3.12	PREMISES INFORMATION BOX ADDED
F 27.9.12	SCA ADDED TO LOBBY DOORS
G 3.2.15	CLEANER'S STORE ADDED
H 26.9.16	EXTINGUISHER POSITIONS & TYPES UPDATED
J 23.5.17	ELECTRICAL SHUT-OFF POINT ADDED

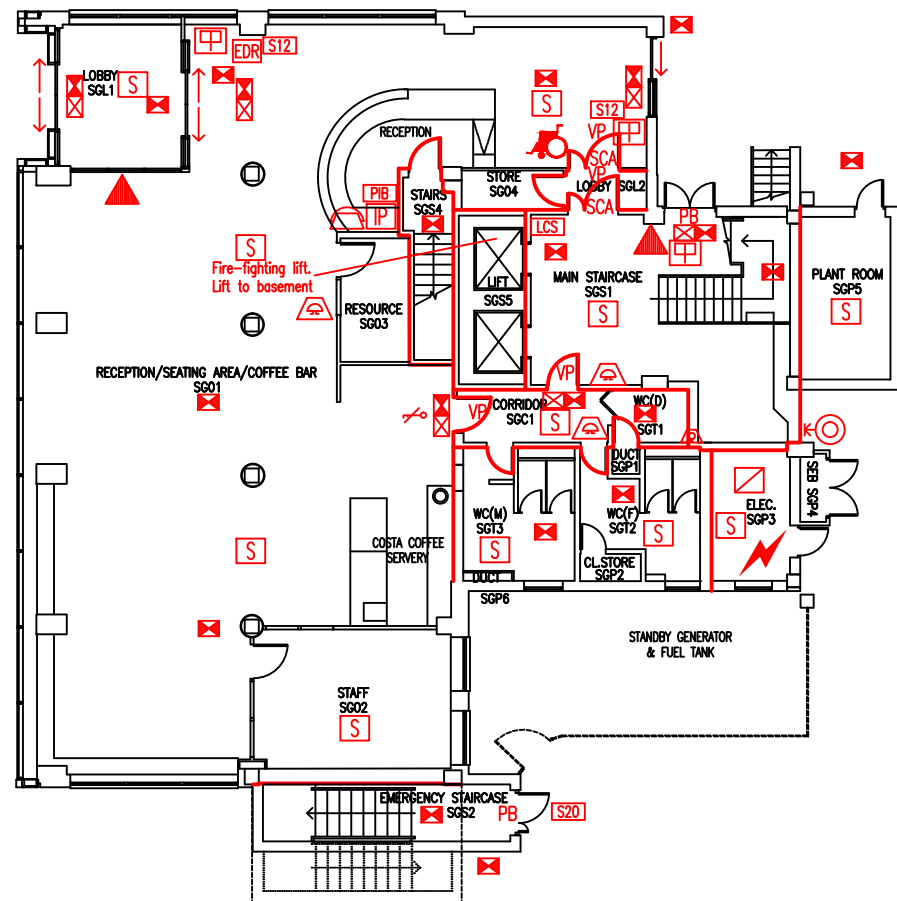

- Key to Fire Symbols
- Existing fire resisting construction 30 min.
 - Existing Evac chair
 - Wheelchair refuge intercom master panel
 - Existing fire alarm control panel
 - Existing electricity main control
 - Existing lift control switch
 - Existing pressure vent
 - Existing premises information board
 - Existing 6 litre P50 foam fire extinguisher
 - Existing call point - manual
 - Existing dry riser inlet
 - Existing exit sign - internally illuminated
 - Existing emergency lighting luminaire
 - Existing audible warning device
 - Existing visual warning device
 - Existing smoke detector
 - Area covered by existing smoke detection
 - Existing emergency door release call point - manual
 - Existing pushbar door ironmongery
 - Existing vision panel
 - Door fitted with lock which is immediately openable from side indicated, without the use of a key or draw/barrel bolt
 - Existing fire action sign - general
 - Existing fire safety sign - fire door keep shut
 - Existing fire safety sign - fire door keep locked
 - Existing fire safety sign - door to be unlocked
 - Existing fire safety sign - fire escape keep clear
 - Existing fire exit sign
 - Existing self closing automatic release
 - Electrical shut-off point for building

GROUND FLOOR
FIRE PLAN

STUDLAND HOUSE

SH/FP/2J

SCALE 1:200 at A3
SEPTEMBER 2004

