






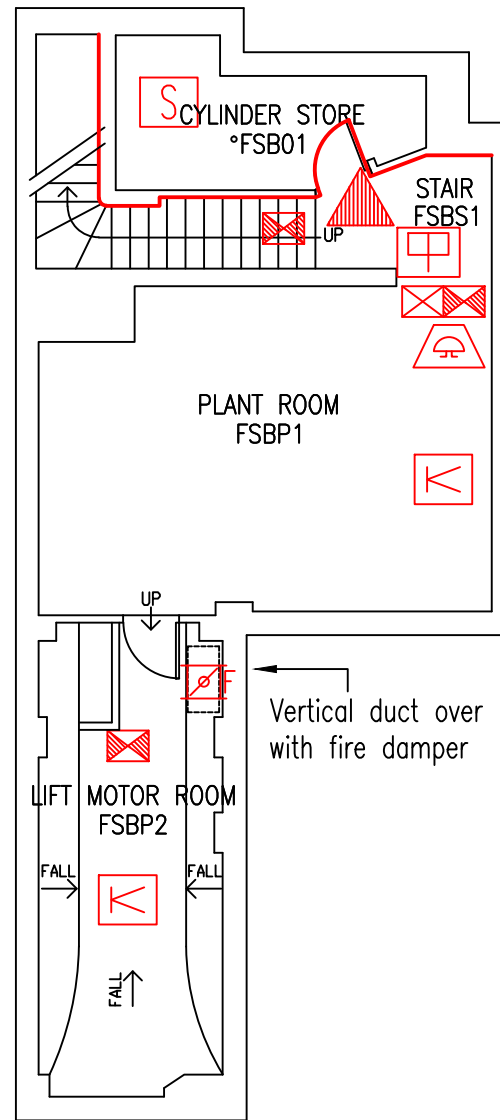


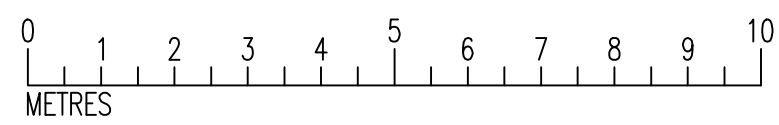


| DATE | REVISION |
|------------|---|
| A 19.11.09 | PLAN UPDATED FOLLOWING MEASURED SURVEY |
| B 20.4.10 | PLAN UPDATED FOLLOWING FSD'S SURVEY |
| C 28.10.14 | CALL POINT ADDED FOLLOWING FSD'S SURVEY |
| D 26.9.16 | EXTINGUISHER POSITIONS & TYPES UPDATED |



- Key to Fire Symbols (existing)
-  Existing fire resisting construction 30 min.
 -  Existing 6 litre P50 foam fire extinguisher
 -  Existing exit sign – internally illuminated
 -  Existing emergency lighting luminaire
 -  Existing smoke detector
 -  Existing heat detector
 -  Existing fire damper in ductwork
 -  Existing audible warning device
 -  Existing call point – manual



BASEMENT
FIRE PLAN

THE OLD FIRE
STATION

FS/FP/5D

SCALE 1:100 at A3
DECEMBER 2006

