










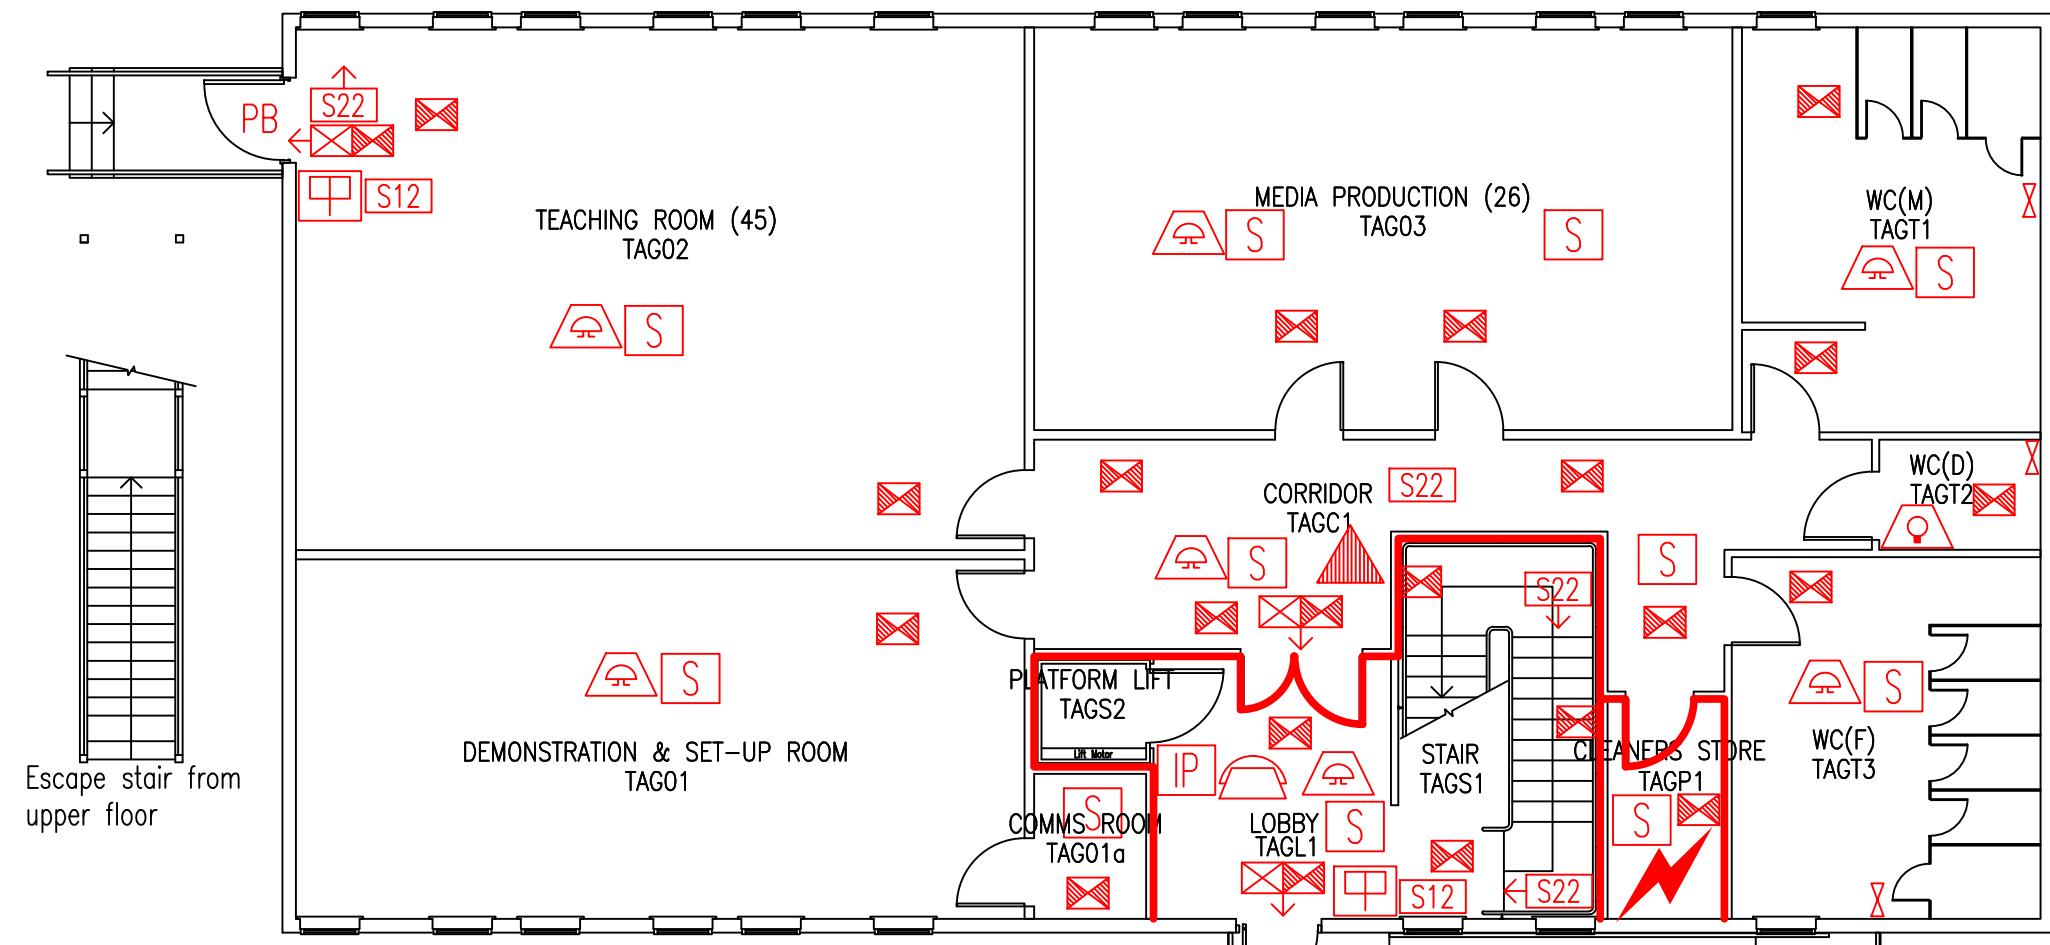








DATE	REVISION
A 9.9.16	TAG01 & TAG03 ROOM NAMES UPDATED
B 26.9.16	EXTINGUISHER POSITIONS & TYPES UPDATED
C 9.6.17	ELECTRICAL SHUT-OFF POINT ADDED



-  Wheelchair refuge intercom master panel
-  Existing fire alarm control panel
-  Existing 60 minutes fire resisting construction
-  Existing call point – manual
-  Existing audible warning device – bell
-  Existing visual warning device
-  Existing smoke detector
-  Existing ventilation fan
-  Existing internally illuminated exit sign
-  Existing emergency lighting luminaire
-  Existing fire action sign – general
-  Existing fire exit sign
-  Denotes directional arrow on existing fire exit sign
-  Existing pushbar door ironmongery
-  Existing 6 litre P50 foam fire extinguisher
-  Electrical shut-off point for building

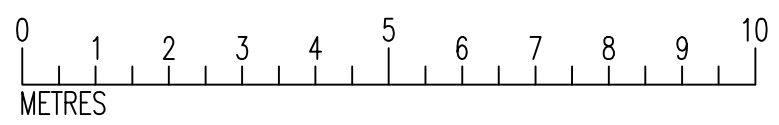

GROUND FLOOR
FIRE PLAN

TOLPUDDLE HOUSE
ANNEXE 1

TPHA1/FP/1C

SCALE 1:100 at A3
31st AUGUST 2011

