











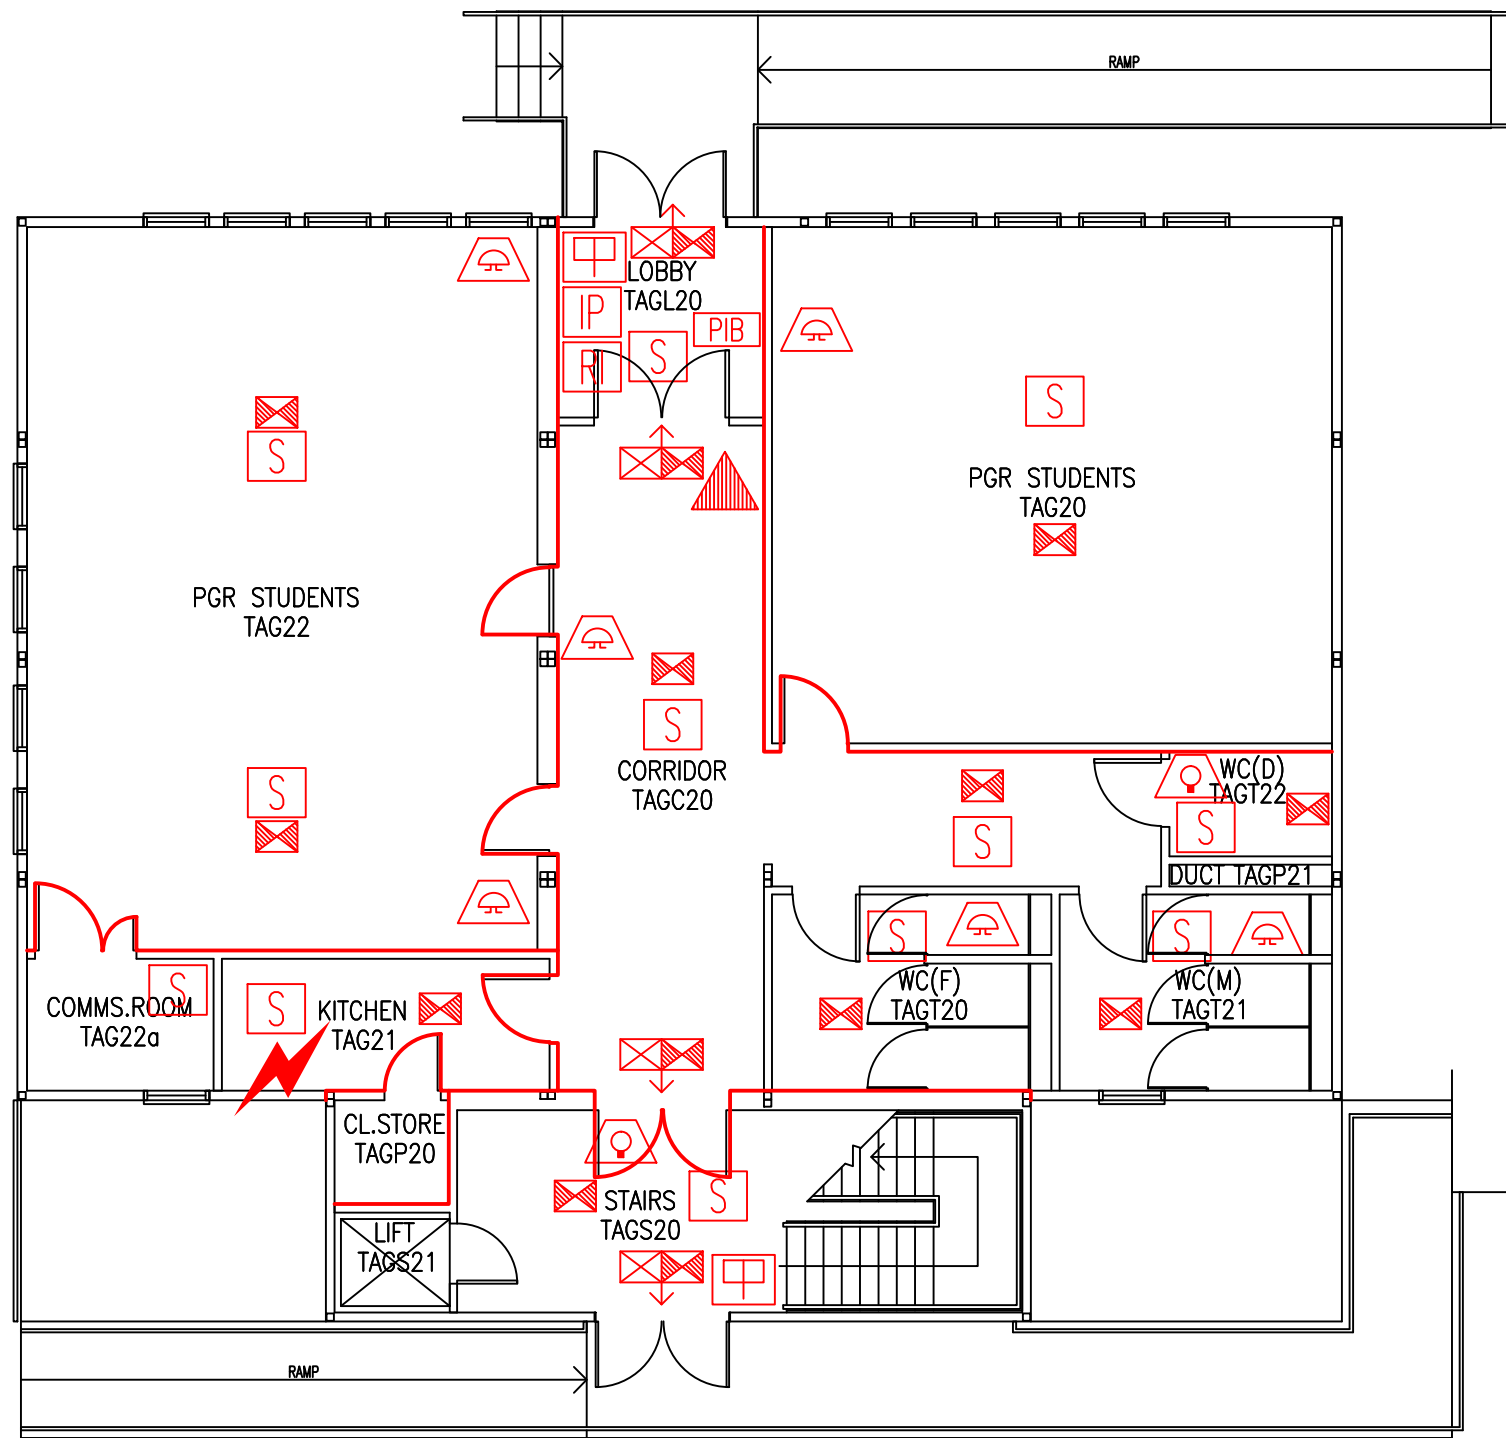




DATE	REVISION
A 16.3.12	PREMISES INFORMATION BOX ADDED
B 9.9.16	TAG20 & TAG22 CHANGED TO 'PGR STUDENTS'
C 26.9.16	EXTINGUISHER POSITIONS & TYPES UPDATED
D 9.6.17	ELECTRICAL SHUT-OFF POINT ADDED



-  Existing exit sign – internally illuminated
-  Existing emergency lighting luminaire
-  Existing call point – manual
-  Existing audible warning device
-  Existing visual warning device
-  Existing smoke detector
-  Denotes directional arrow on existing fire exit sign
-  Existing 6 litre P50 foam fire extinguisher
-  Existing fire resisting construction 30 min.
-  Existing refuge indicator panel
-  Existing fire alarm control panel
-  Existing premises information board
-  Electrical shut-off point for building

GROUND FLOOR
FIRE PLAN

TOLPUDDLE HOUSE
ANNEXE 2

TPHA2/FP/1D

SCALE 1:100 at A3
SEPTEMBER 2007

