
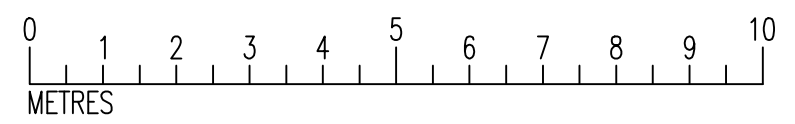


DATE	REVISION
A 26.9.16	EXTINGUISHER POSITIONS & TYPES UPDATED
B 4.1.17	TA130 CHANGED TO 'PGR STUDY SPACE'
C 7.6.18	TA130 CHANGED TO 'PG BASE ROOM'

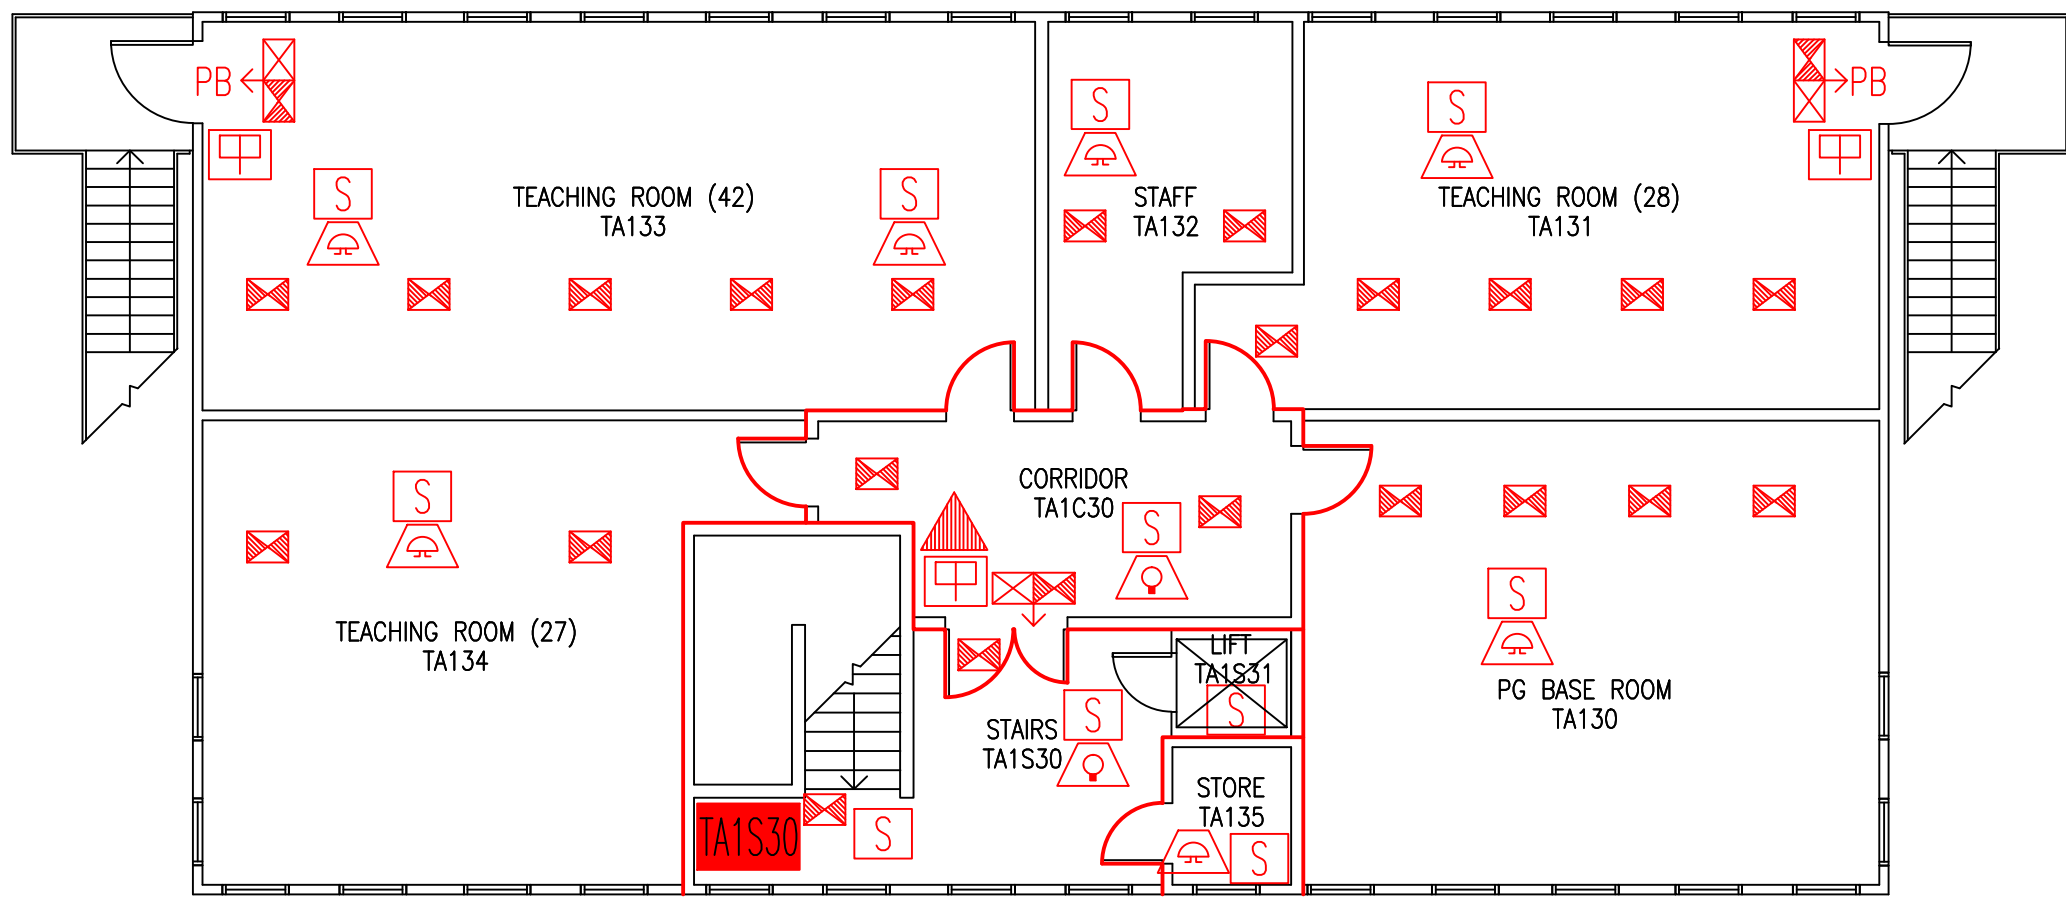

- TA1S30 Existing wheelchair refuge zone
- Existing fire resisting construction 30 min.
- Existing 6 litre P50 foam fire extinguisher
- Existing call point – manual
- Existing smoke detector
- Existing exit sign – internally illuminated
- Existing emergency lighting luminaire
- Denotes directional arrow on existing fire exit sign
- PB Existing pushbar door ironmongery
- Existing audible warning device
- Existing visual warning device

FIRST FLOOR
FIRE PLAN

TOLPUDDLE HOUSE
ANNEXE 3

TPHA3/FP/2C

SCALE 1:100 at A3
26th SEPTEMBER 2013

