










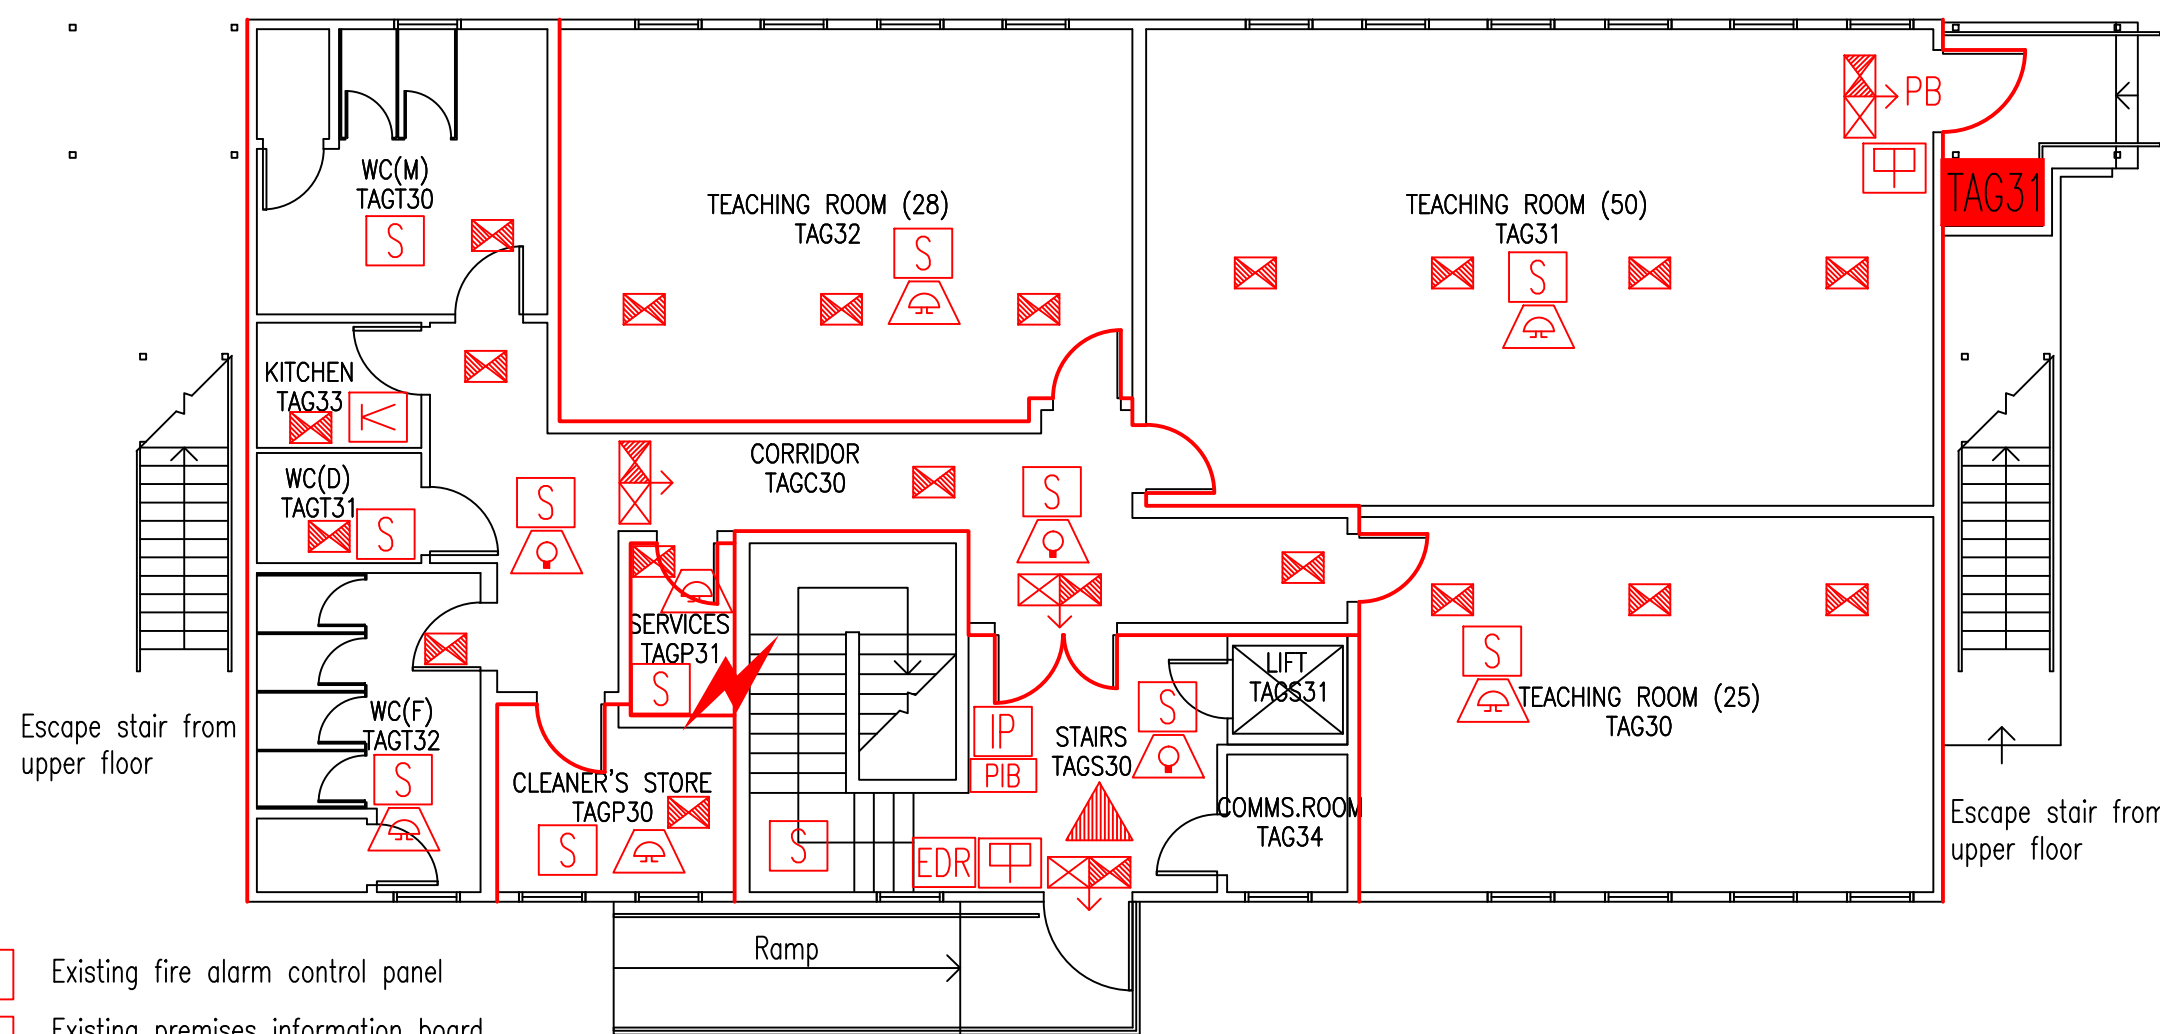







DATE	REVISION
A 26.9.16	EXTINGUISHER POSITIONS & TYPES UPDATED
B 9.6.17	ELECTRICAL SHUT-OFF POINT ADDED



-  Existing fire alarm control panel
-  Existing premises information board
-  Existing wheelchair refuge zone
-  Existing fire resisting construction 30 min.
-  Existing 6 litre P50 foam fire extinguisher
-  Existing call point – manual
-  Existing smoke detector
-  Existing exit sign – internally illuminated
-  Existing emergency lighting luminaire
-  Denotes directional arrow on existing fire exit sign
-  Existing emergency door release call point – manual
-  Existing pushbar door ironmongery
-  Existing audible warning device
-  Existing visual warning device
-  Existing heat detector
-  Electrical shut-off point for building

GROUND FLOOR  
FIRE PLAN

TOLPUDDLE HOUSE  
ANNEXE 3

TPHA3/FP/1B

SCALE 1:100 at A3  
11th SEPTEMBER 2013

